


**NOTES:**

1. DIVER GRID MARKERS SHALL BE 45-MIL, 3-PLY, SCRIM REINFORCED, POTABLE GRADE, CSPE MATERIAL. COLOR SHALL BE WHITE TOP.
2. DIVER GRID MARKERS SHALL BE PROVIDED AT 100' O/C EACH WAY.
3. PROVIDE GRID MARKERS AT THE FOLLOWING GRID LOCATIONS:  



A1 THROUGH	A5
B1 THROUGH	B5
C1 THROUGH	C5
D1 THROUGH	D5

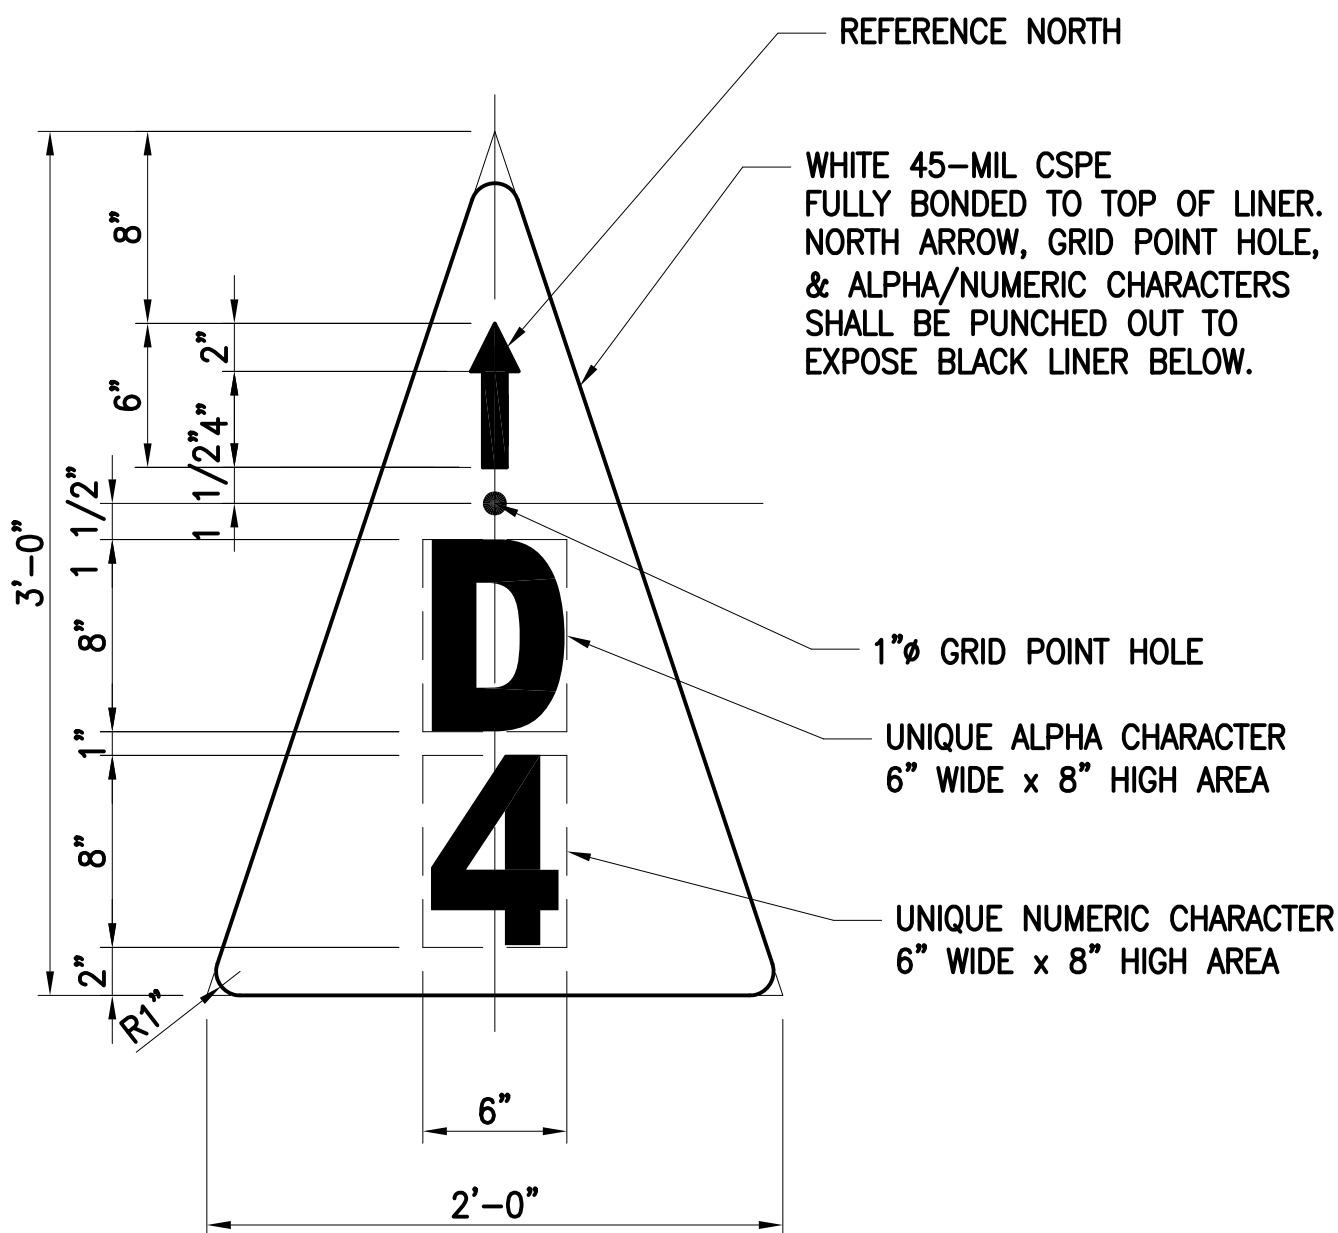

NOTE: DIVER GRID MARKER D6 SHOWN FOR REFERENCE. EACH DIVER MARKER HAS UNIQUE ALPHA-NUMERIC DESIGNATION.


**DIVER GRID MARKER**

SCALE: 1 1/2"=1'-0"

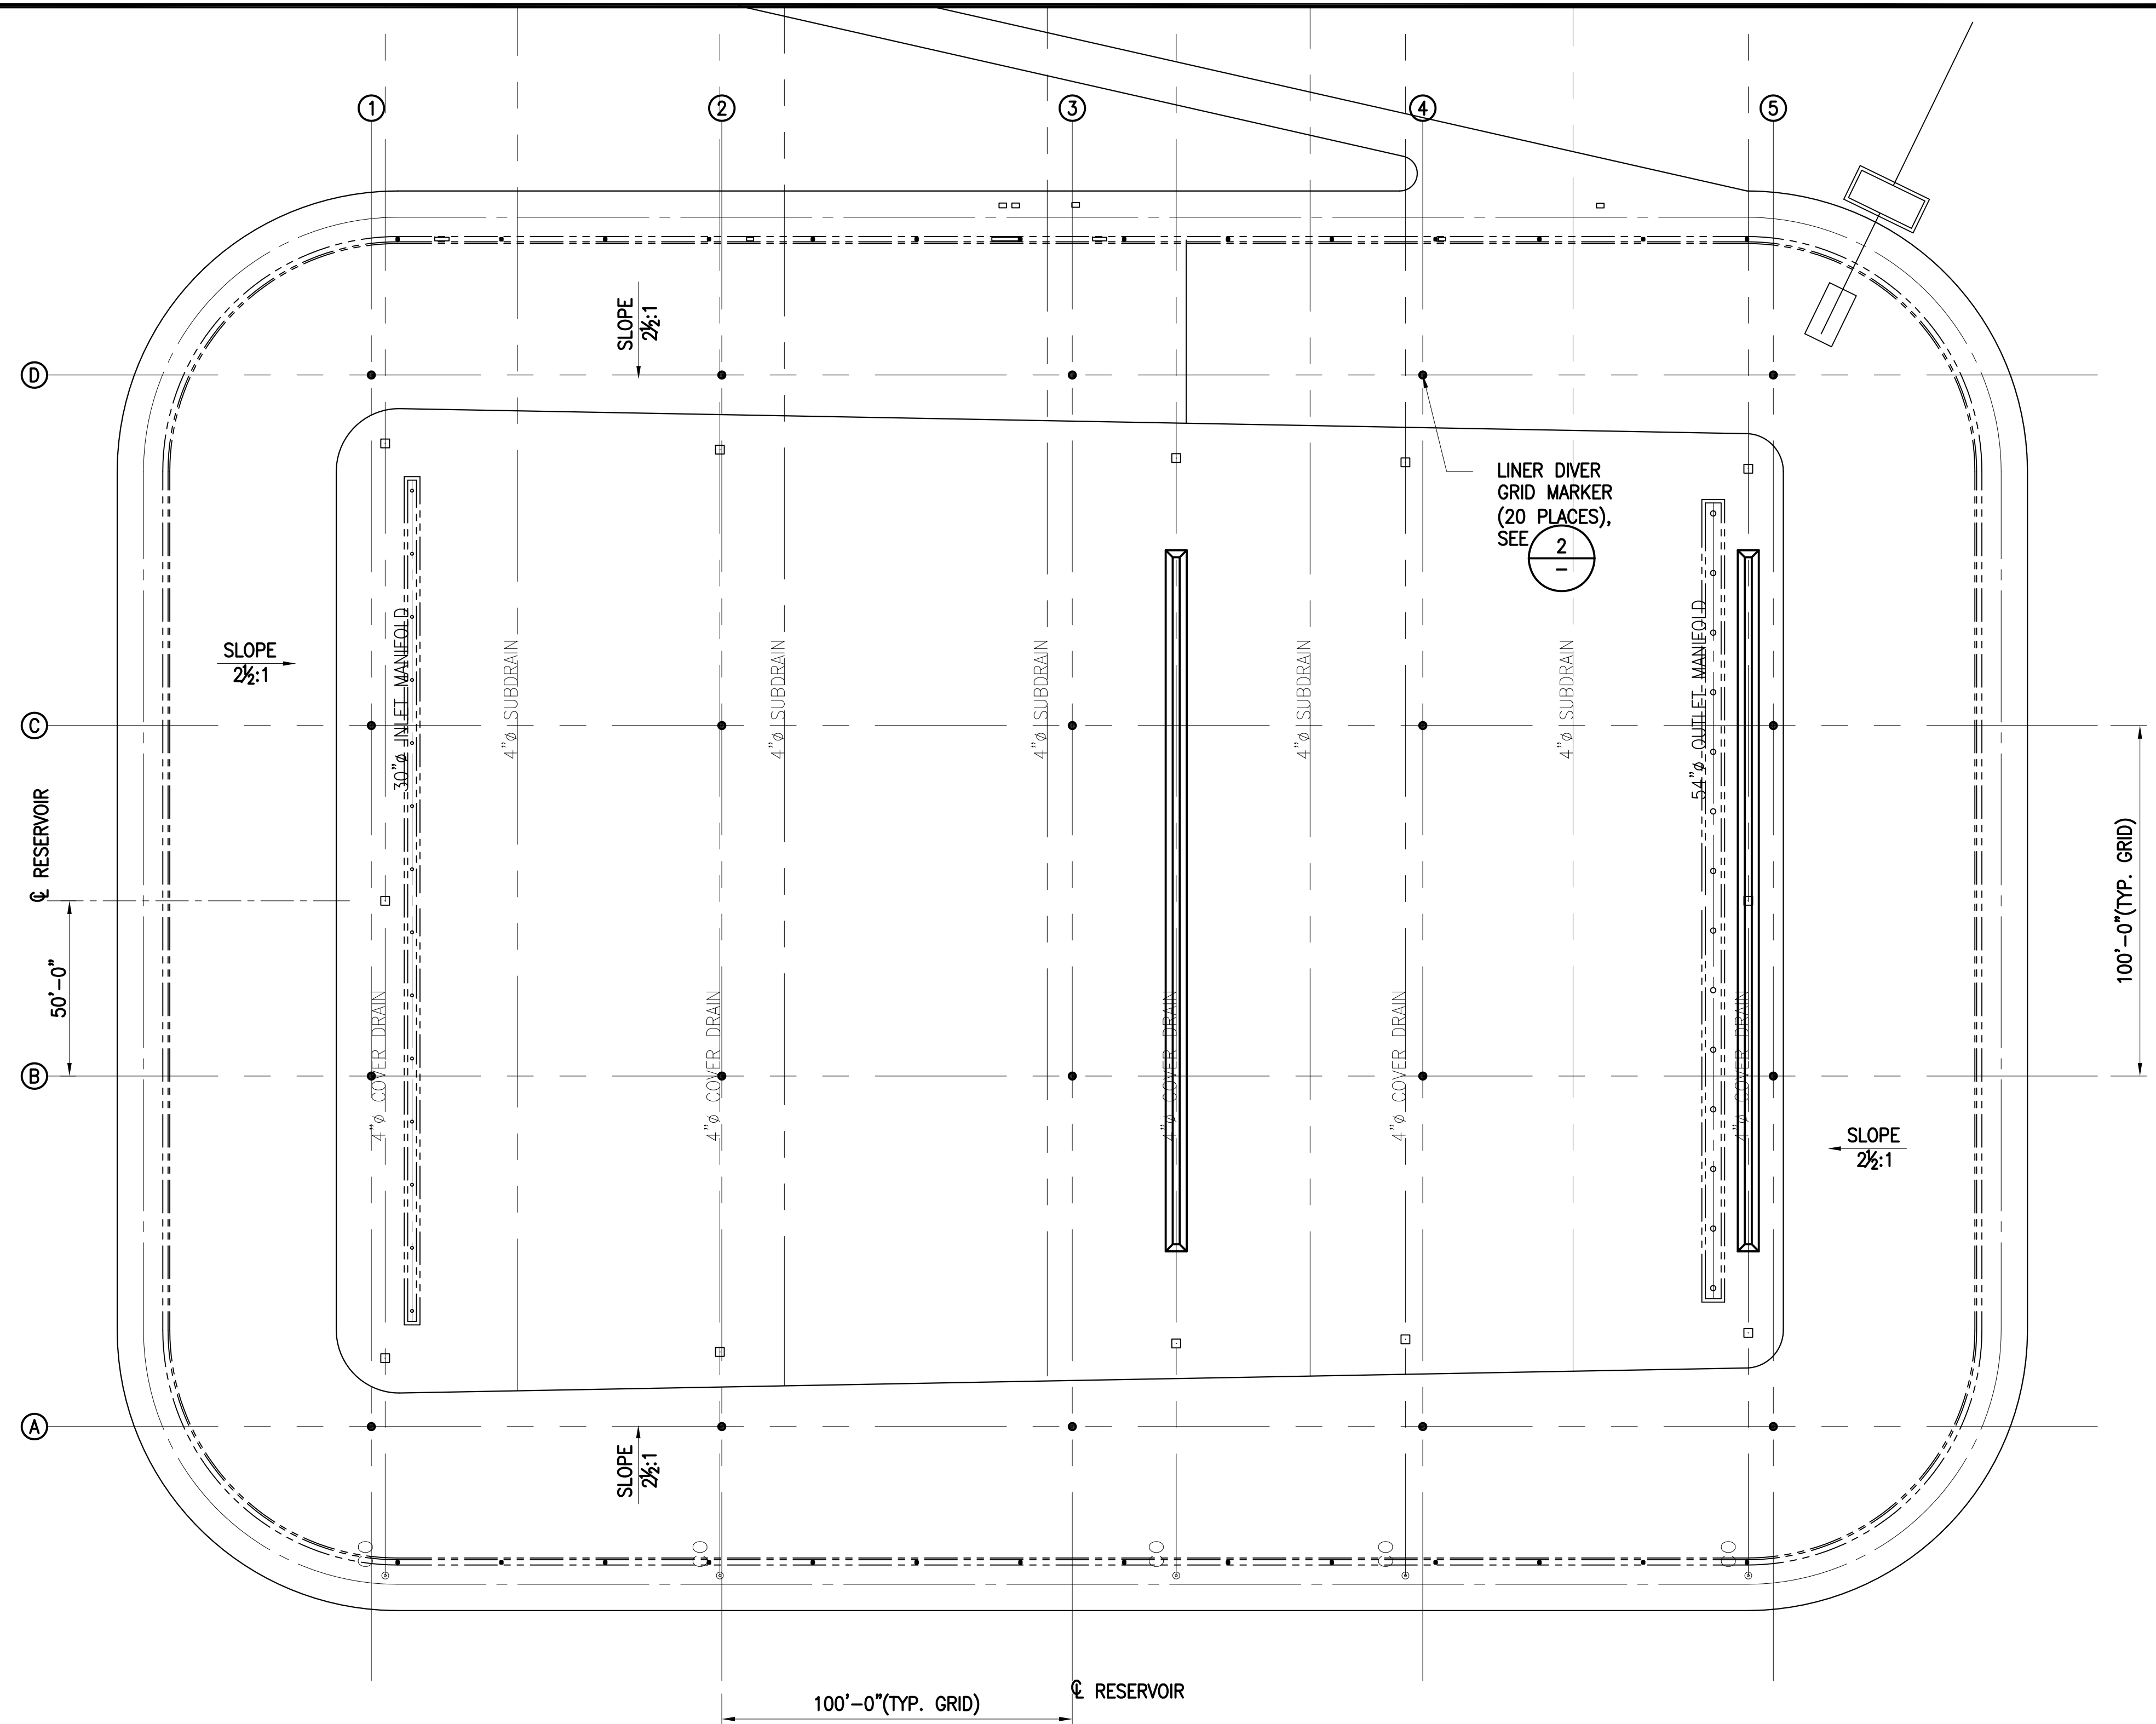


**LINER GRID MARKER PLAN**

SCALE: 1"=30'




REVISION	DESCRIPTION	BY	APP	DATE
1	BID ADDENDUM 1, DARKEND GRID LINES	HCG		9/14

WORK ORDER NO. 14-0003  
 DESIGNED \_\_\_\_\_  
 DRAWN \_\_\_\_\_  
 DATE AUGUST 2014  
 CHECKED \_\_\_\_\_  
 SUBMITTED \_\_\_\_\_  
 RECOMMENDED \_\_\_\_\_  
 APPROVED \_\_\_\_\_

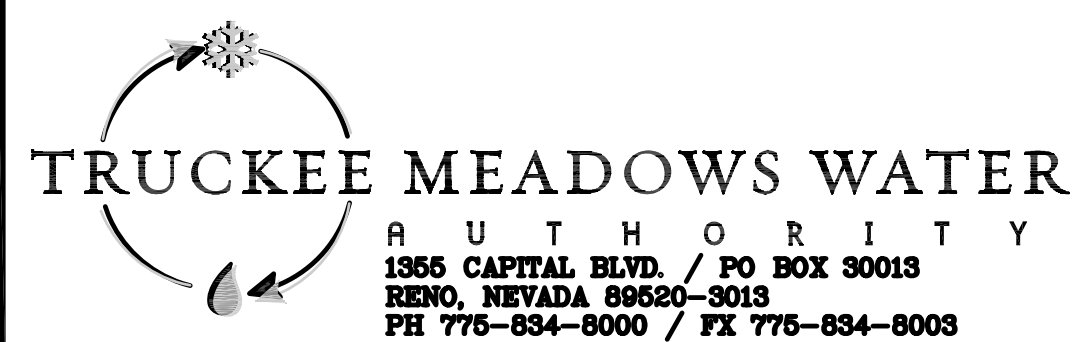

**NOT REPRODUCIBLE**  
 PROPERTY OF TRUCKEE MEADOWS WATER AUTHORITY. RETURN UPON COMPLETION OF PROJECT (Per Homeland Security Act)

**HIGHLAND RESERVOIR**  
**RENO, NEVADA**  
**LINER**  
**DIVER GRID MARKER PLAN**

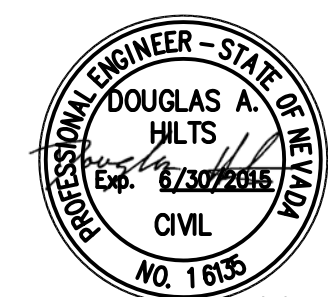

SHEET NUMBER  
**C-205**  
 17 OF 49